


6' SIDEWALK WITH WALL  
NTS

**NOTES:**

1. IN LOCATIONS WHERE WALL HEIGHT DOES NOT EXCEED 1', THE TOE WALL AND WEEP HOLES CAN BE OMITTED.
2. IN LOCATIONS WHERE WALL IS 24" TO 48" THE TOE WALL SHALL BE 1' DEPTH.
3. STEEL REINFORCING IN WALL SHALL BE #3 BARS @ 12" CENTERS HORIZONTALLY AND #4 BARS @ 8" CENTERS VERTICALLY.
4. REDWOOD JOINTS IN WALL SHALL MATCH REDWOOD JOINTS IN THE SIDEWALK. THE WALL SHALL BE DOUBLE CHAMFERED AT THE REDWOOD LOCATIONS.
5. ENDS OF WALL SHALL ALSO BE CHAMFERED.
6. CONCRETE TO HAVE COMPRESSIVE STRENGTH OF 3600 psi at 28 DAYS.
7. PRE-MOLDED MATERIAL WITH REMOVABLE CAP STRIP. SEAL WITH NON-SAG GRAY SILICONE SEALANT, TXDOT CLASS 4 PREQUALIFIED JOINT SEALER.
8. EXPOSED FACE OF WALL SHALL HAVE FORMLINER FINISH.

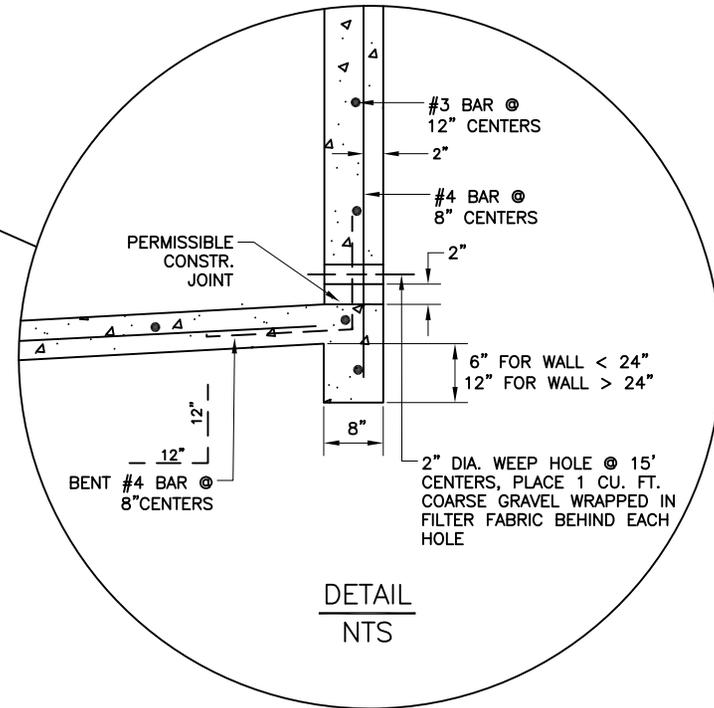

DETAIL  
NTS



CITY OF ARLINGTON, TEXAS

**SIDEWALK 6 WITH WALL**

DATE:	SCALE: NTS	SHEET _____ OF _____
DESIGNED BY:	DRAWN BY:	CHECKED BY: