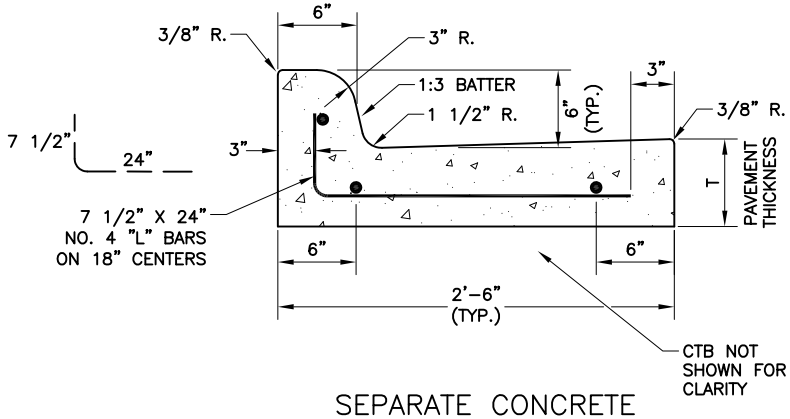

SEPARATE CONCRETE
CURB & GUTTER

N.T.S.

NOTES:

1. REINFORCEMENT SHALL BE NO. 4 BARS.
2. CONCRETE SHALL BE 5 1/2 SACK – 3600 PSI.
3. TOOLED JOINTS SHALL BE PLACED AT FIVE FOOT INTERVALS OR MATCHING ABUTTING SIDEWALK JOINTS AND PAVEMENT JOINTS.
4. EXPANSION JOINTS SHALL BE PLACED AT ALL INTERSECTIONS PC'S, PT'S DRIVEWAYS, INLETS, OTHER CURB AND GUTTER OR EVERY 200 FEET.
5. SEPARATE CURB AND GUTTER SHALL BE PLACED ON 8 INCH CEMENT TREATED BASE (CTB). CTB IS SUBSIDIARY TO CURB AND GUTTER UNIT PRICE.

CITY OF ARLINGTON, TEXAS		
SEPARATE CONCRETE CURB & GUTTER		
DATE:	SCALE: NTS	SHEET____OF____
DESIGNED BY:	DRAWN BY:	CHECKED BY: