


WALL FORMLINER  
ELEVATION N.T.S.

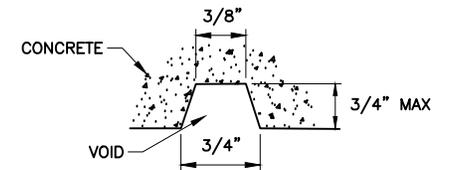

RUSTICATION STRIP  
DETAIL N.T.S.

**NOTES:**

FOR STANDARD WALLS WITH SURFACE TREATMENT.

1. STONE FORMLINER SHALL BE AN ELASTOMERIC-URETHANE FORM LINER WITH 3/4" DEPTH RELIEF, PATTERN NO. 167A ASHLAR STONE "A" AS PROVIDED BY SCOTT SYSTEM OR APPROVED EQUAL. STONE FORMLINER SHALL BE INCIDENTAL TO THE UNIT COST FOR BID ITEMS FOR SIDEWALK WITH LOW WALL.
2. INSTALL IMPRINTED CONCRETE IN ACCORDANCE WITH THE FORMLINER DETAILS AND MANUFACTURER'S CURRENT SPECIFICATIONS.
3. IF MEMBRANE CURING, CURING COMPOUND SHALL BE TYPE 1 CLEAR OR TRANSLUCENT AND SHALL COMPLY WITH SPECIAL PROVISIONS SECTION 12.3.



CITY OF ARLINGTON, TEXAS

**WALL FORMLINER**

DATE:	SCALE: NTS	SHEET: OF
DESIGNED BY:	DRAWN BY:	CHECKED BY: