


PLAN

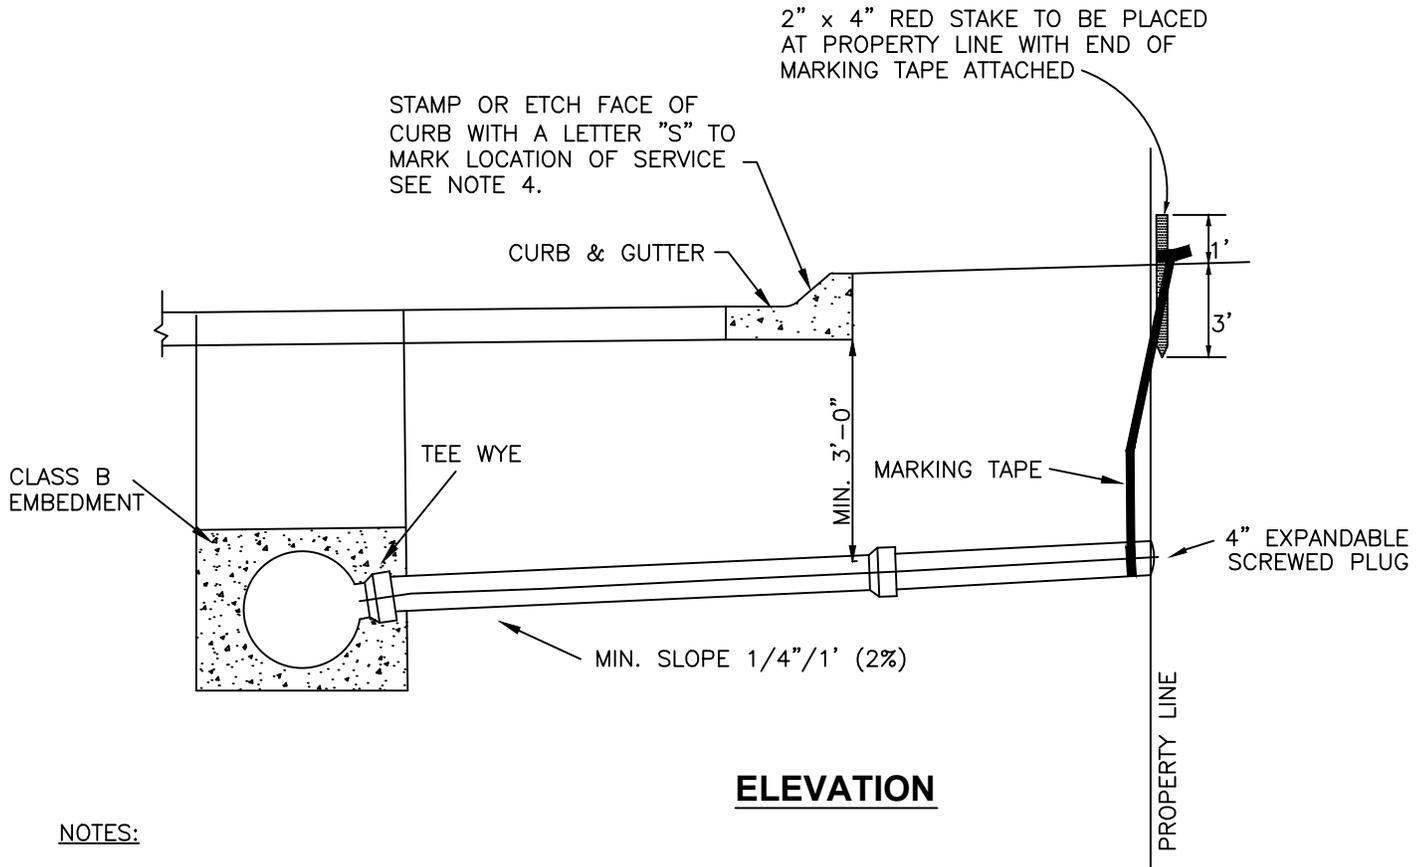

ELEVATION

NOTES:

1. SERVICES WITH LESS THAN 2' CLEARANCE UNDER AN EXISTING OR PROPOSED STORM DRAIN SHALL BE DUCTILE IRON OR SHALL BE CONCRETE ENCASED.
2. SERVICES SHALL BE SDR-26 PVC PIPE WITH CLASS B EMBEDMENT.
3. NEW SERVICE TAPS ON EXISTING MAINS REQUIRE INSERTA-TEE CONNECTION OR APPROVED EQUAL.
4. SERVICES 6" AND LARGER REQUIRE A MANHOLE TO CONNECT TO MAIN.
5. STAMPING OR ETCHING CURB WITHIN CITY OF ARLINGTON ENTERTAINMENT DISTRICT IS NOT ALLOWED. BENCHMARK MEDALLION MAY BE REQUIRED IN LIEU OF STAMPING OR ETCHING.

FIGURE 23
SANITARY SEWER SERVICE
ARLINGTON WATER UTILITIES