


CUT 3" WIDE OPENING IN STEEL COVER TO PROVIDE ACCESS TO 2" SCH. 40 VENT PIPE

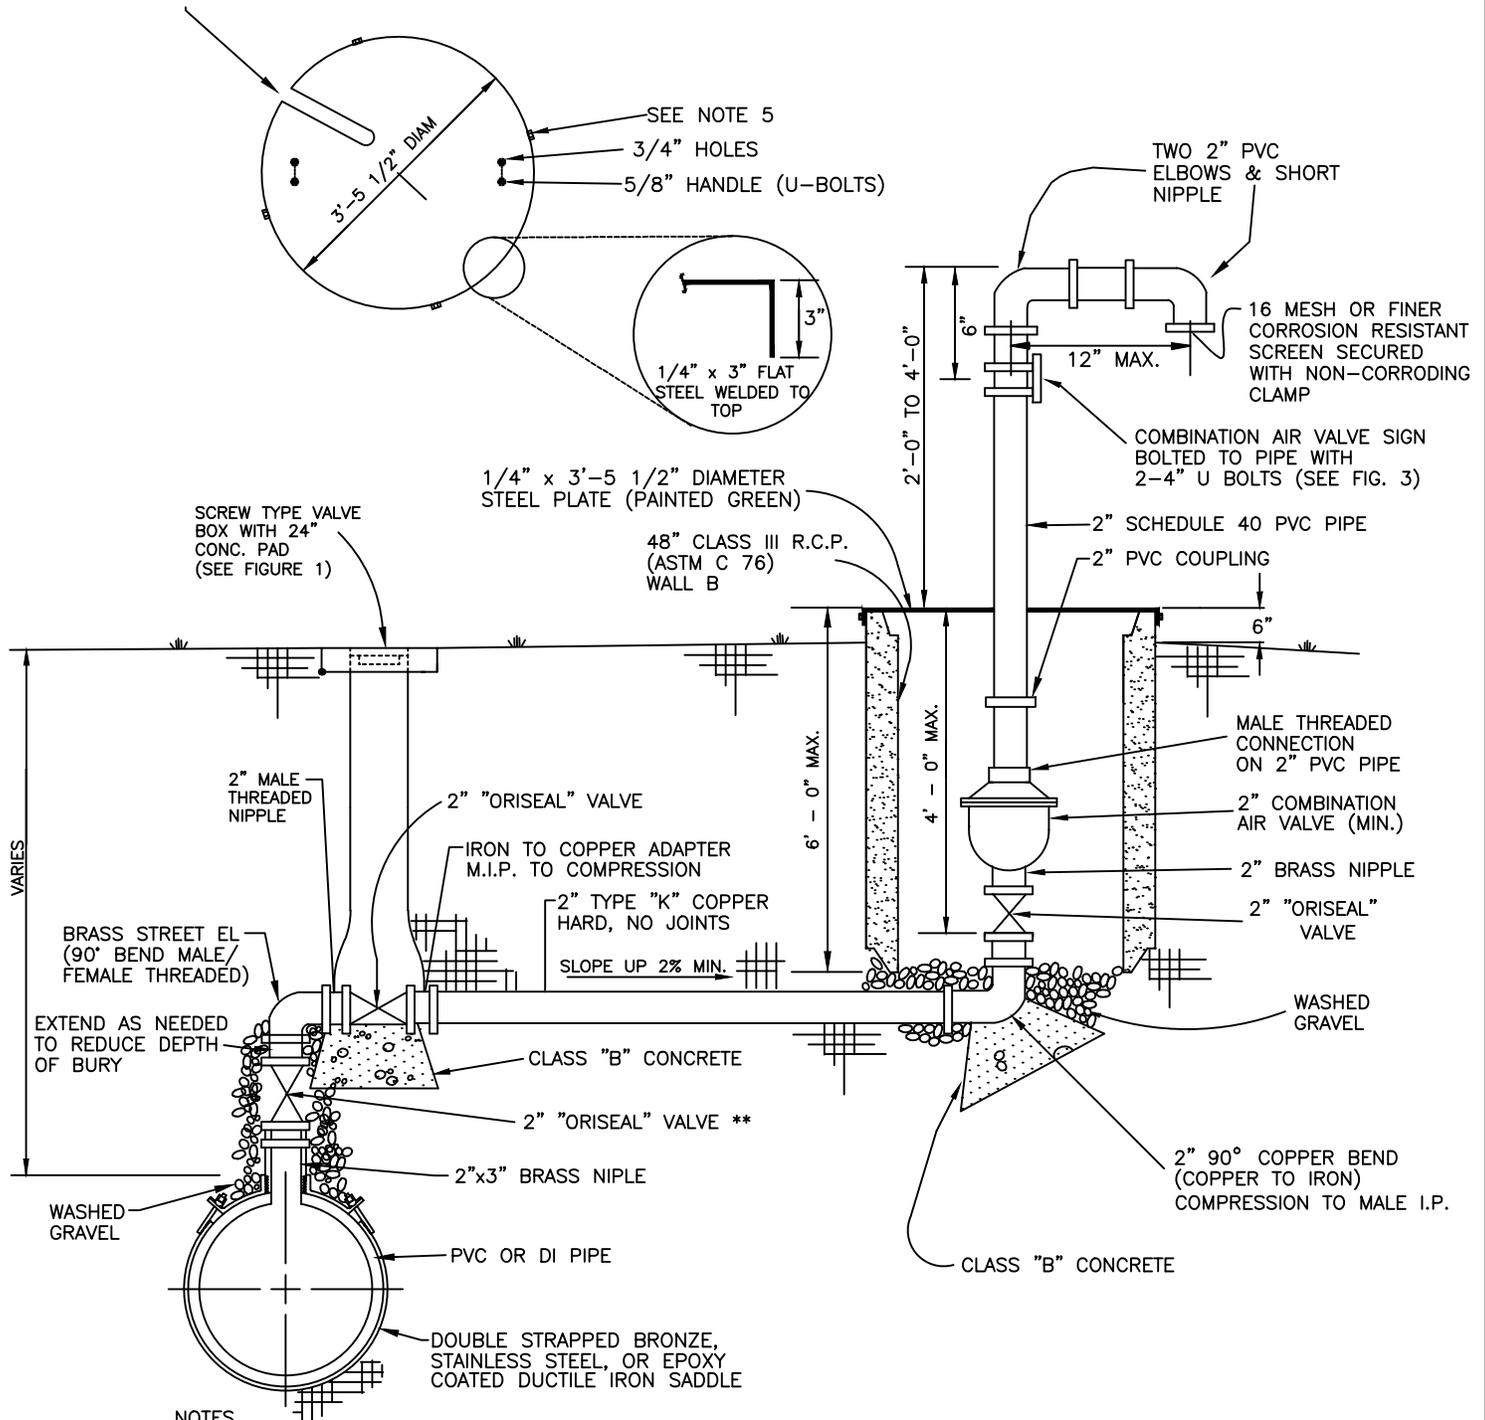

NOTES

1. ALL PIPING, FITTINGS, AND VALVES SHOWN ARE FOR 2" COMBINATION AIR VALVE. FOR COMBINATION AIR VALVE INSTALLATION LARGER THAN 2", ALL PIPING, FITTINGS, AND VALVES SHALL BE THE SAME SIZE AS AIR VALVE.
 2. ALL ABOVE GROUND METAL PIPING, FITTINGS, SIGNS, ETC., SHALL BE BRUSH PAINTED WITH TWO COATS OF GREEN PAINT TO MATCH STEEL PLATE LID.
 3. WRAP SERVICE SADDLE WITH TWO LAYERS OF POLYETHYLENE ENCASUREMENT PER SECTION B17.
 4. ALL CONNECTIONS FOR NEW CONSTRUCTION SHALL BE MADE WITH FITTINGS AND BE FLANGED OR MJ RESTRAINED WITH APPROVED RETAINER GLANDS/MEGALUGS.
 5. LID REQUIRES SET BOLTS USING 4 EACH 3/8-16 X 1.5" 18-8 STAINLESS STEEL TAP BOLT COURSE THREADED INTO SIDE OF STEEL LID. (USE 5/16" HOLE)
- ** 2" ORISEAL VALVE REQUIRED WHEN INSTALLING NEW TAP ON EXISTING MAIN. VALVE IS NOT REQUIRED ON NEW CONSTRUCTION

FIGURE 8
2" COMBINATION AIR VALVE OFFSET INSTALLATION
ARLINGTON WATER UTILITIES